



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia


iTec 5 SP



A++



A



■ 04 kW
■ 05 kW
■ 05 kW



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 5 SP





55 °C

35 °C



A++

A++

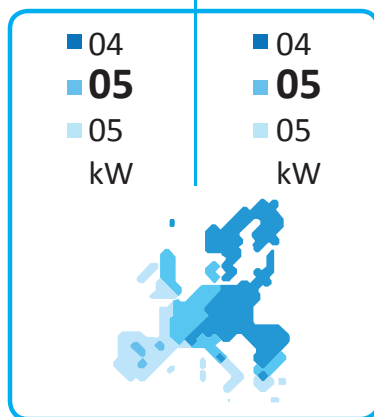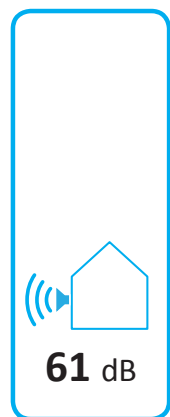

2015

811/2013




ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 5 SP



A++



A



+



+



+



+



A++



A

2015

811/2013

Thermia



iTec 9



A⁺⁺



A



Thermia

iTec 9




55 °C

35 °C






A⁺⁺

A⁺⁺

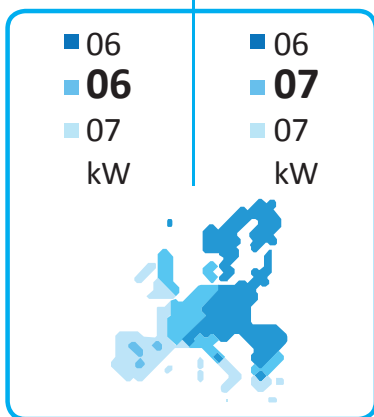


Thermia

iTec 9

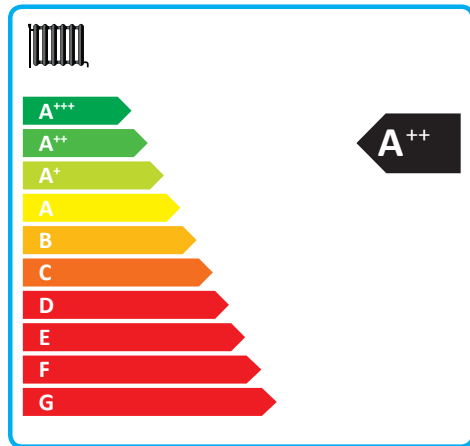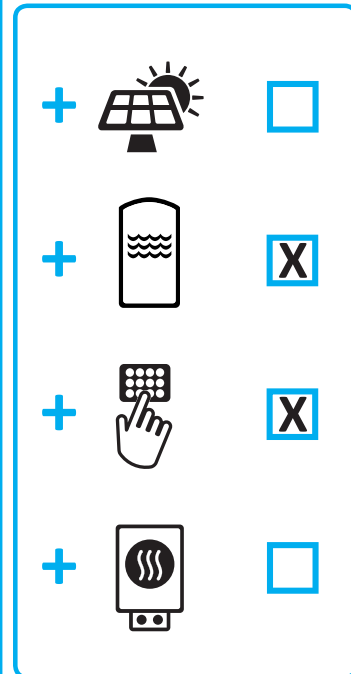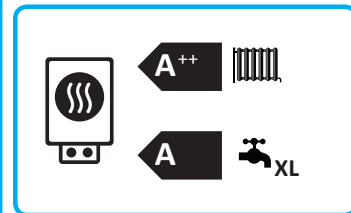

A⁺⁺

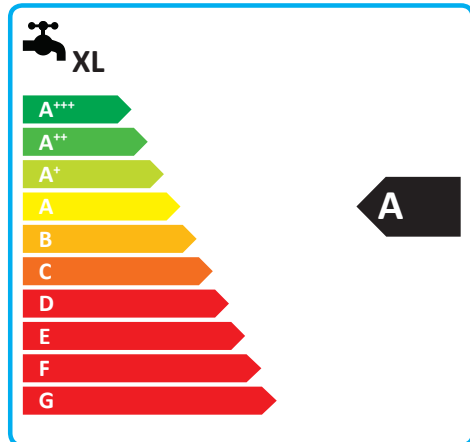

A




ENERG Y IJA
енергия · ενεργεια IE IA

Thermia



iTec 9 SP



A++

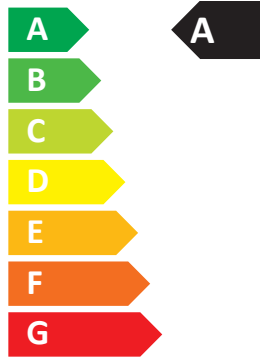

A



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 9 SP




55 °C

35 °C



A++

A++

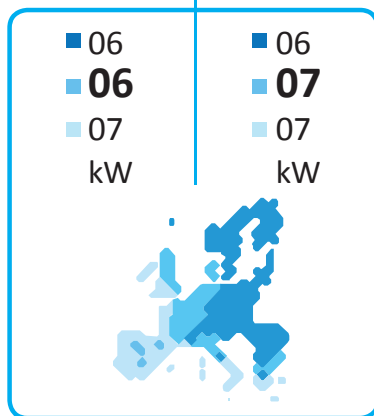

2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 9 SP



A++



A



+



+



+



+



A++



A

2015


811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 16

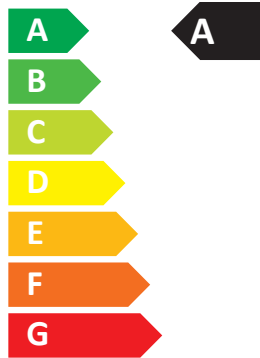

■ 10 kW
■ 10 kW
■ 10 kW



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA


Thermia

iTec 16



55 °C

35 °C

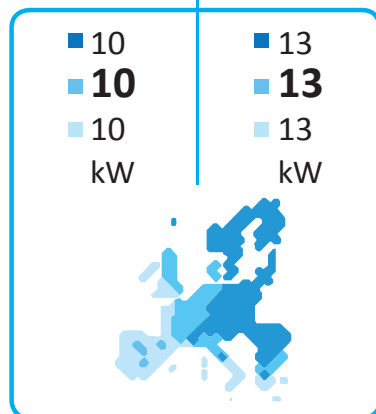

2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 16



+



□

+



X

+




X

+



□

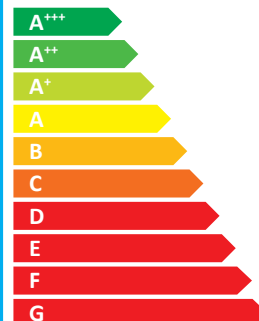

2015

811/2013




ENERG Y IJA
енергия · ενεργεια IE IA

Thermia


iTec 16 SP



A+

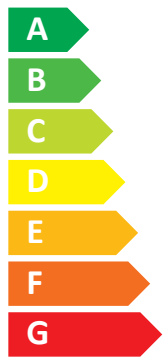

A



■ 10 kW
■ **10 kW**
■ 10 kW



2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 16 SP



55 °C

35 °C



A+

A++



■ 10 kW
■ **10 kW**
■ 10 kW

■ 13 kW
■ **13 kW**
■ 13 kW

2015

811/2013



ENERG Y IJA
енергия · ενεργεια IE IA

Thermia

iTec 16 SP



A+



A



A+

+



+



+



+



A

2015

811/2013